




Step-by-step installation instructions:

1. Ensure the aperture is free from dust and debris.
2. Cut the necessary length of AGNI-Wrap 50mm.
3. Secure AGNI-Wrap 50 around the pipe with no overlap using AGNI-Strap.
4. Insert AGNI-Wrap 50 into the annular space, with 25mm of the wrap extending outside the aperture both sides.
5. Using AGNI-Seal, seal the gaps between AGNI-Wrap 50 and the wall.
6. Apply a 5mm bead of sealant at the AGNI-Wrap 50 / pipe junction.

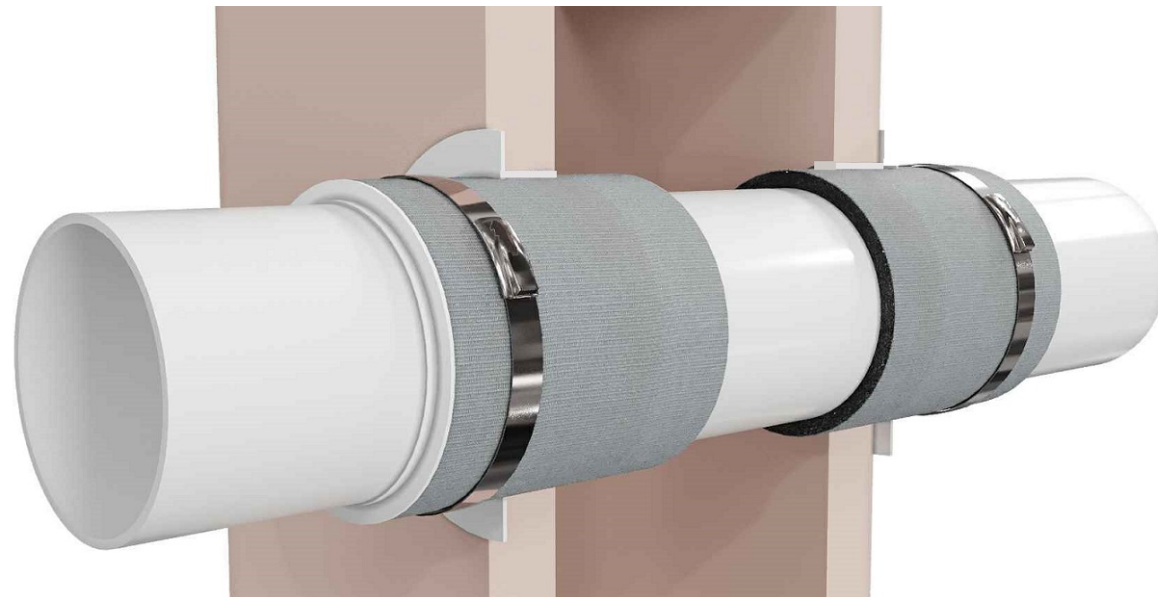

Technical Information

Substrate	<ul style="list-style-type: none"> • Min. 90mm timber or steel stud wall with a minimum of one layer of 13mm (or greater) FR plasterboard on each side, with or without insulation. • Min. 116mm concrete wall
Service range	DN 40mm up to 100mm PVC-U pipe
Annular gap	3.5 - 9mm
AGNI-Products	AGNI-Wrap 50, AGNI-Strap, AGNI-Seal
Protection installation	From both sides of the wall

Compliance Information

Standards	AS1530.4-2014, AS4072.1-2005
FRR/FRL	DN 40mm up to DN 80mm -/60/60 DN 100mm -/60/45
Reference	PF24069 (AP-074)

Disclaimer

Agnitek reserves the right to modify product specifications without prior notice due to its ongoing research, development & certification programme. The information in this document is provided in good faith and is intended for guidance purposes only. Any accompanying drawings are solely for illustrative purposes. Since Agnitek cannot oversee installation methods or ensure site conditions, no warranties, expressed or implied, are intended regarding the products' actual performance. We do not accept liability for any loss, damage, or injury from using this information. Please take a look at the test reports displayed on a relevant AGNI-System webpage for all compliance specifics.






FIRESTOP CENTRE

Authorised New Zealand Distributor
Ph (09) 483 4000 www.firestopcentre.co.nz

AGNI-Wrap in 1 x 13mm Plasterboard Wall or 116mm Concrete Wall 40-100mm PVC-U Pipe Max FRR -/60/60

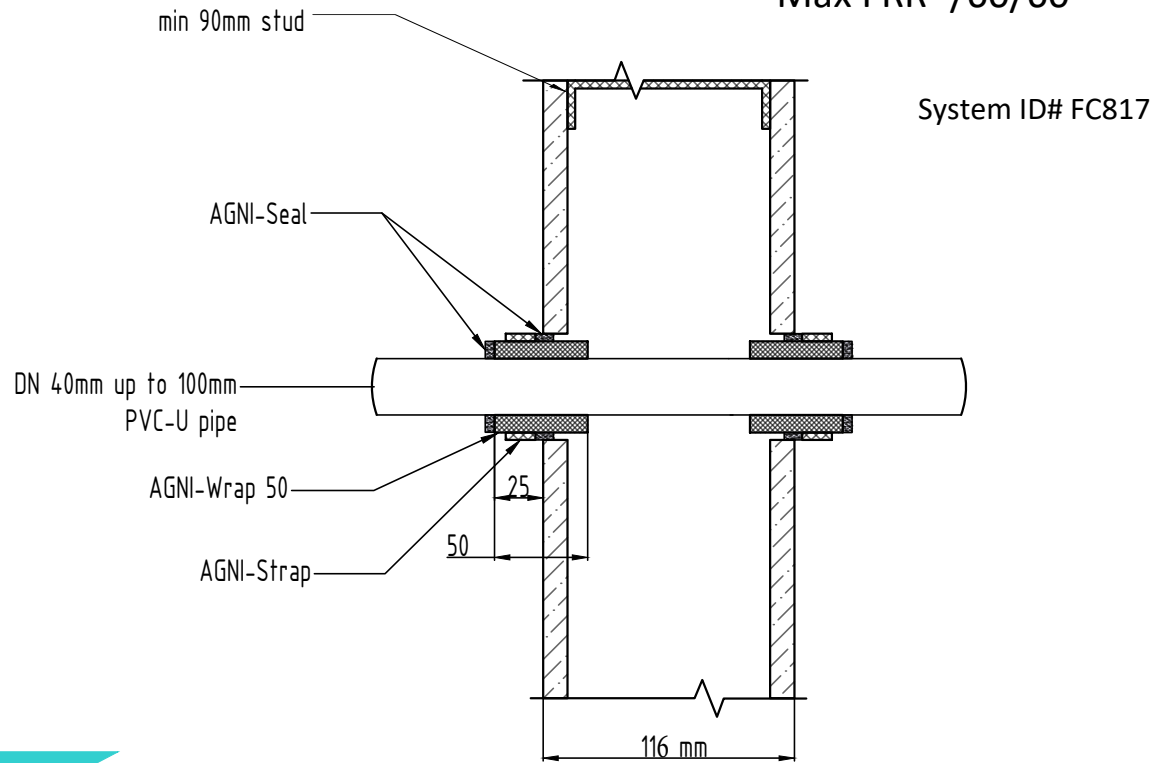

Technical Information

Substrate	<ul style="list-style-type: none"> • Min. 90mm timber or steel stud wall with a minimum of one layer of 13mm (or greater) FR plasterboard on each side, with or without insulation. • Min. 116mm concrete wall
Service range	DN 40mm up to 100mm PVC-U pipe
Annular gap	3.5 - 9mm
AGNI-Products	AGNI-Wrap 50, AGNI-Strap, AGNI-Seal
Protection installation	From both sides of the wall

Compliance Information

Standards	AS1530.4-2014, AS4072.1-2005
FRR/FRL	DN 40mm up to DN 80mm -/60/60 DN 100mm -/60/45
Reference	PF24069



Agnitek
FIRE RATED TECHNOLOGY

8 Clare St Bayswater
VIC 3153, AUSTRALIA
www.agnitek.com.au

Disclaimer
Agnitek reserves the right to modify product specifications without prior notice due to its ongoing research, development & certification programme. The information in this document is provided in good faith and is intended for guidance purposes only. Any accompanying drawings are solely for illustrative purposes. Since Agnitek cannot oversee installation methods or ensure site conditions, no warranties, expressed or implied, are intended regarding the products' actual performance. We do not accept liability for any loss, damage, or injury from using this information. Please take a look at the test reports displayed on a relevant AGNI-System webpage for all compliance specifics.

Date | 18.07.2024