


**AGNI-Wrap in 2 x 13mm Plasterboard Wall or
 116mm Concrete Wall
 20mm PEX Pipe, Max FRR -/120/120**

Step-by-step installation instructions:

1. Ensure the aperture is free from dust and debris.
2. Install 1x layer of AGNI-Wrap around the pipe allowing a 10mm overlap.
3. Fix AGNI-Wrap with an AGNI-Strap at mid-width.
4. Recess within the annular gap and flush with the surface of the wall.
5. Fill annular gap with AGNI-Seal to a depth of 26mm i.e. full depth of plasterboard lining.

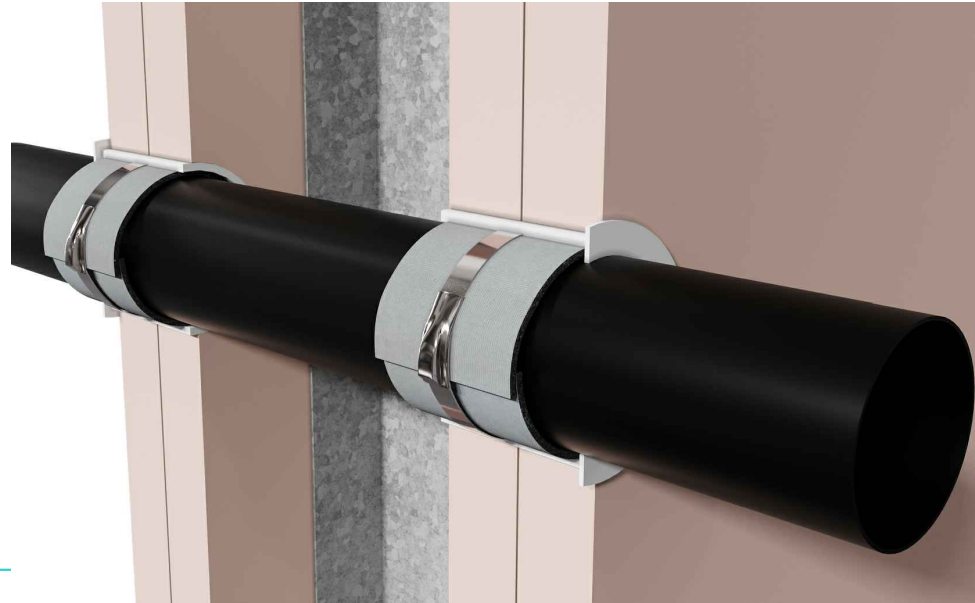

System ID# FC830

Technical Information

Substrate	<ul style="list-style-type: none"> • 2x 13mm FR plasterboard-lined wall with 64mm steel framing (uninsulated) • ≥116mm concrete wall
Service type	DN 20mm PEX pipe
Size	Inner diameter (ID): 14.5mm Outer diameter (OD): 20.5mm Thickness (T): 3mm
AGNI-Wrap layers	1
Annular gap	Min: 0mm Max: 9.5mm
AGNI-Products	AGNI-Seal, AGNI-Wrap
Protection installation	Symmetrical

Compliance Information

Standards	AS1530.4-2014, AS4072.1-2005
FRR/FRL	-/120/120
Reference	RIRF24019 (AP-048FCC)

Disclaimer
 Agnitek reserves the right to modify product specifications without prior notice due to its ongoing research, development & certification programme. The information in this document is provided in good faith and is intended for guidance purposes only. Any accompanying drawings are solely for illustrative purposes. Since Agnitek cannot oversee installation methods or ensure site conditions, no warranties, expressed or implied, are intended regarding the products' actual performance. We do not accept liability for any loss, damage, or injury from using this information. Please take a look at the test reports displayed on a relevant AGNI-System webpage for all compliance specifics.



Agnitek
 FIRE RATED TECHNOLOGY
 8 Clare St Bayswater
 VIC 3153, AUSTRALIA
 www.agnitek.com.au


Date 20.06.2024



FIRESTOP CENTRE

Authorised New Zealand Distributor
Ph (09) 483 4000 www.firestopcentre.co.nz

AGNI-Wrap in 2 x 13mm Plasterboard Wall or 116mm Concrete Wall 20mm PEX Pipe, Max FRR -/120/120

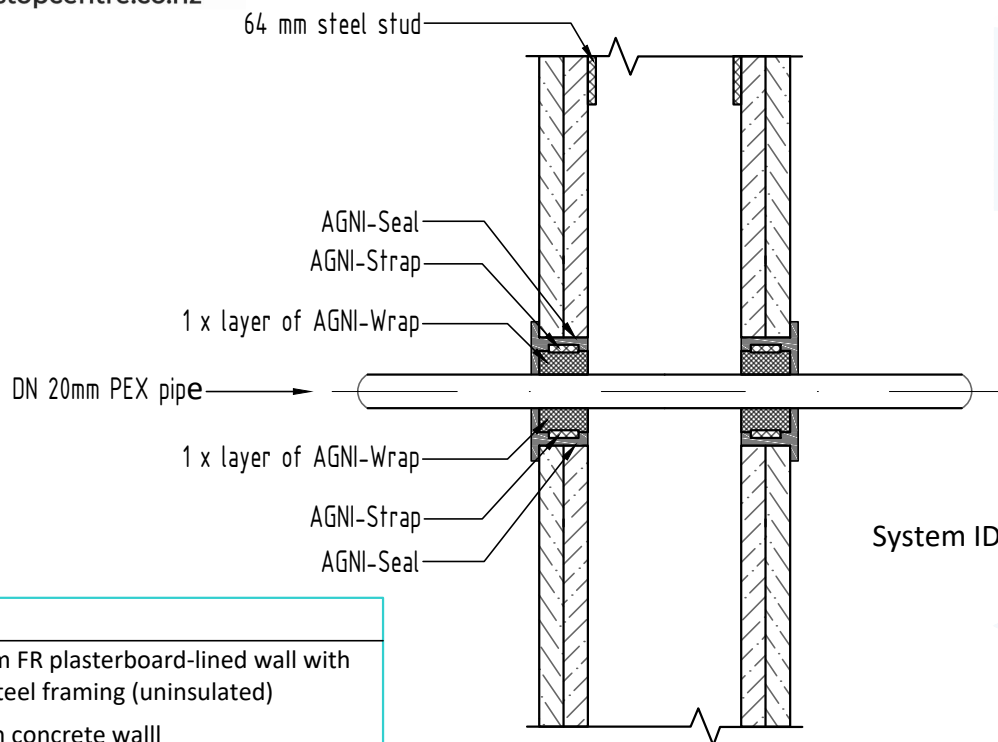

Technical Information

Substrate	<ul style="list-style-type: none"> • 2x 13mm FR plasterboard-lined wall with 64mm steel framing (uninsulated) • ≥116mm concrete wall
Service type	DN 20mm PEX pipe
Size	Inner diameter (ID): 14.5mm Outer diameter (OD): 20.5mm Thickness (T): 3mm
AGNI-Wrap layers	1
Annular gap	Min: 0mm Max: 9.5mm
AGNI-Products	AGNI-Seal, AGNI-Wrap
Protection installation	Symmetrical

Compliance Information

Standards	AS1530.4-2014, AS4072.1-2005
FRR/FRL	-/120/120
Reference	PF24019



Agnitek
FIRE RATED TECHNOLOGY

8 Clare St Bayswater
VIC 3153, AUSTRALIA
www.agnitek.com.au

Date 20.06.2024

Disclaimer
Agnitek reserves the right to modify product specifications without prior notice due to its ongoing research, development & certification programme. The information in this document is provided in good faith and is intended for guidance purposes only. Any accompanying drawings are solely for illustrative purposes. Since Agnitek cannot oversee installation methods or ensure site conditions, no warranties, expressed or implied, are intended regarding the products' actual performance. We do not accept liability for any loss, damage, or injury from using this information. Please take a look at the test reports displayed on a relevant AGNI-System webpage for all compliance specifics.