



FIRESTOP CENTRE

Authorised New Zealand Distributor
Ph (09) 483 4000 www.firestopcentre.co.nz

AGNI-Wrap in a Hebel Wall (min 75mm)

PEX Pipe 25mm
Max FRR -/120/120

System ID# FC831

Step-by-step installation instructions:

1. Ensure the aperture is free from dust and debris.
2. Insert one revolution of AGNI-Wrap 50 into the annular gap each side of the wall leaving approx 12mm protruding outside the Hebel panel.
3. Apply AGNI-Black between AGNI-Wrap 50 and the pipe, finishing flush with the protruding AGNI-Wrap 50.
4. Apply 12mm x 12mm AGNI-Black fillet/cone between AGNI-Wrap and the wall.



Agnitek[®]
FIRE RATED TECHNOLOGY

8 Clare St Bayswater
VIC 3153, AUSTRALIA
www.agnitek.com.au

Technical Information

Substrate	Min. 75mm Hebel Wall
Service range	DN25mm PEX pipe
Annular gap	8.2 - 13.0mm
AGNI-Products	AGNI-Wrap 50, AGNI-Black
Protection installation	From both sides of the wall

Compliance Information

Standards	AS1530.4-2014, AS4072.1-2005
FRR/FRL	-/120/120
Reference	PF24145

Disclaimer

Agnitek reserves the right to modify product specifications without prior notice due to its ongoing research, development & certification programme. The information in this document is provided in good faith and is intended for guidance purposes only. Any accompanying drawings are solely for illustrative purposes. Since Agnitek cannot oversee installation methods or ensure site conditions, no warranties, expressed or implied, are intended regarding the products' actual performance. We do not accept liability for any loss, damage, or injury from using this information. Please take a look at the test reports displayed on a relevant AGNI-System webpage for all compliance specifics.

Date 07.03.2025




FIRESTOP CENTRE

Authorised New Zealand Distributor
Ph (09) 483 4000 www.firestopcentre.co.nz

AGNI-Wrap in a Hebel Wall (min 75mm) PEX Pipe 25mm Max FRR -/120/120

System ID# FC831

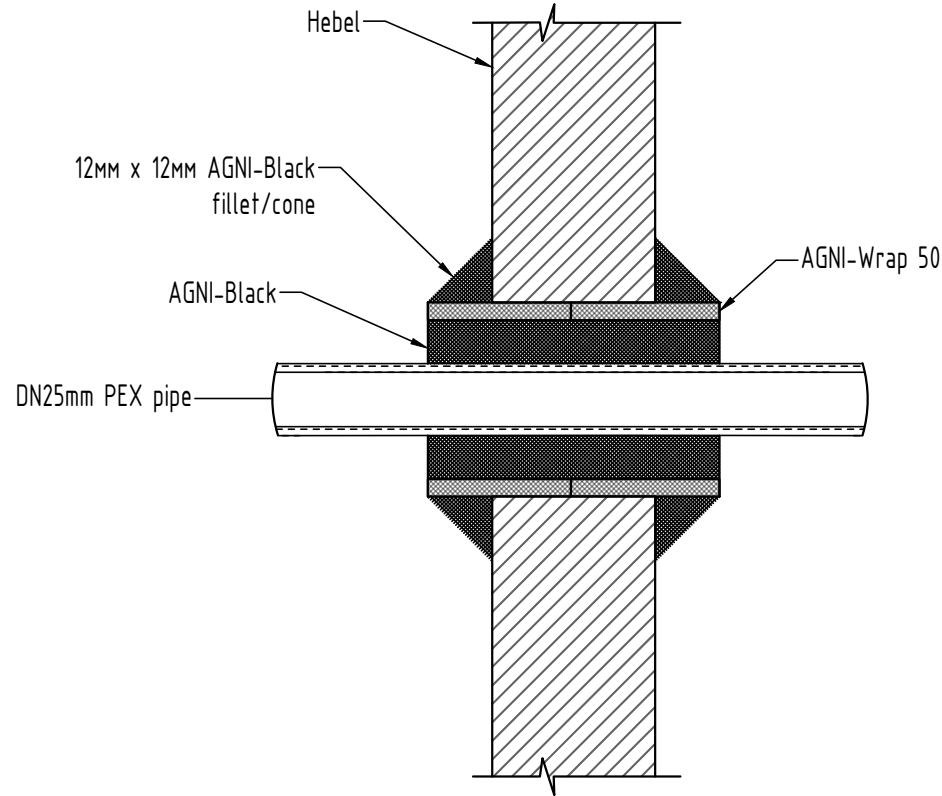

Technical Information

Substrate	Min. 75mm Hebel Wall
Service range	DN25mm PEX pipe
Annular gap	8.2 - 13.0mm
AGNI-Products	AGNI-Wrap 50, AGNI-Black
Protection installation	From both sides of the wall

Compliance Information

Standards	AS1530.4-2014, AS4072.1-2005
FRR/FRL	-/120/120
Reference	PF24145



8 Clare St Bayswater
VIC 3153, AUSTRALIA
www.agnitek.com.au

Disclaimer

Agnitek reserves the right to modify product specifications without prior notice due to its ongoing research, development & certification programme. The information in this document is provided in good faith and is intended for guidance purposes only. Any accompanying drawings are solely for illustrative purposes. Since Agnitek cannot oversee installation methods or ensure site conditions, no warranties, expressed or implied, are intended regarding the products' actual performance. We do not accept liability for any loss, damage, or injury from using this information. Please take a look at the test reports displayed on a relevant AGNI-System webpage for all compliance specifics.

Date	07.03.2025
------	------------