

## AGNI-Wrap in 2 x 13mm Plasterboard Wall or 116mm Concrete Wall

### PEX-AL-PEX Pipe (16mm, 25mm)


### Max FRR -/120/120

#### Step-by-step installation instructions:

1. Ensure the aperture is free from dust and debris.
2. Install 1x layer of AGNI-Wrap around the pipe allowing a 10mm overlap.
3. Fix AGNI-Wrap with an AGNI-Strap at mid-width.
4. Recess within the annular gap and flush with the surface of the wall.
5. Fill annular gap with AGNI-Seal to a depth of 26mm i.e. full depth of plasterboard lining.

#### Technical Information

Substrate	<ul style="list-style-type: none"> <li>• 2x 13mm FR plasterboard-lined wall with 64mm steel framing (uninsulated)</li> <li>• ≥116mm concrete wall</li> </ul>	
Service range	DN 16mm PEX-AL-PEX pipe	DN 25mm PEX-AL-PEX pipe
Size	Inner diameter (ID): 11mm Outer diameter (OD): 16.5mm Thickness (T): 2.5mm	Inner diameter (ID): 19mm Outer diameter (OD): 25mm Thickness (T): 2.5mm
AGNI-Wrap layers	1 layer	1 layer
Annular gap	Min: 6.5mm Max: 11.5mm	Min: 8mm Max: 12mm
AGNI-Products	AGNI-Wrap, AGNI-Seal	
Protection installation	Symmetrical	

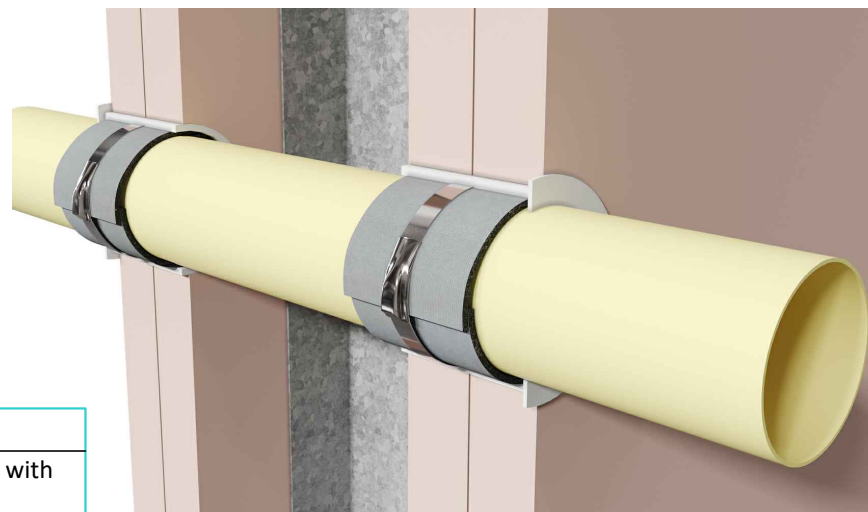

System ID# FC833

#### Compliance Information

Standards	AS1530.4-2014, AS4072.1-2005
FRR/FRL	DN 16mm -/120/120 DN 25mm -/120/60
Reference	RIRF24019 (AP-052FCC)





8 Clare St Bayswater  
VIC 3153, AUSTRALIA  
www.agnitek.com.au

Date	20.06.2024
------	------------

#### Disclaimer

Agnitek reserves the right to modify product specifications without prior notice due to its ongoing research, development & certification programme. The information in this document is provided in good faith and is intended for guidance purposes only. Any accompanying drawings are solely for illustrative purposes. Since Agnitek cannot oversee installation methods or ensure site conditions, no warranties, expressed or implied, are intended regarding the products' actual performance. We do not accept liability for any loss, damage, or injury from using this information. Please take a look at the test reports displayed on a relevant AGNI-System webpage for all compliance specifics.

## AGNI-Wrap in 2 x 13mm Plasterboard Wall or 116mm Concrete Wall PEX-AL-PEX Pipe (16mm, 25mm) Max FRR -/120/120

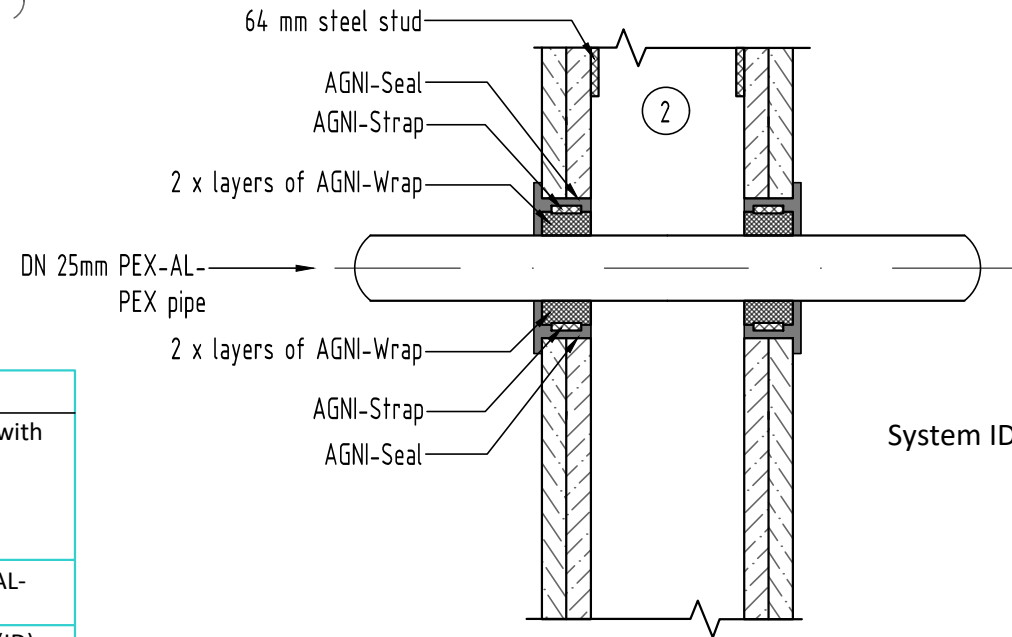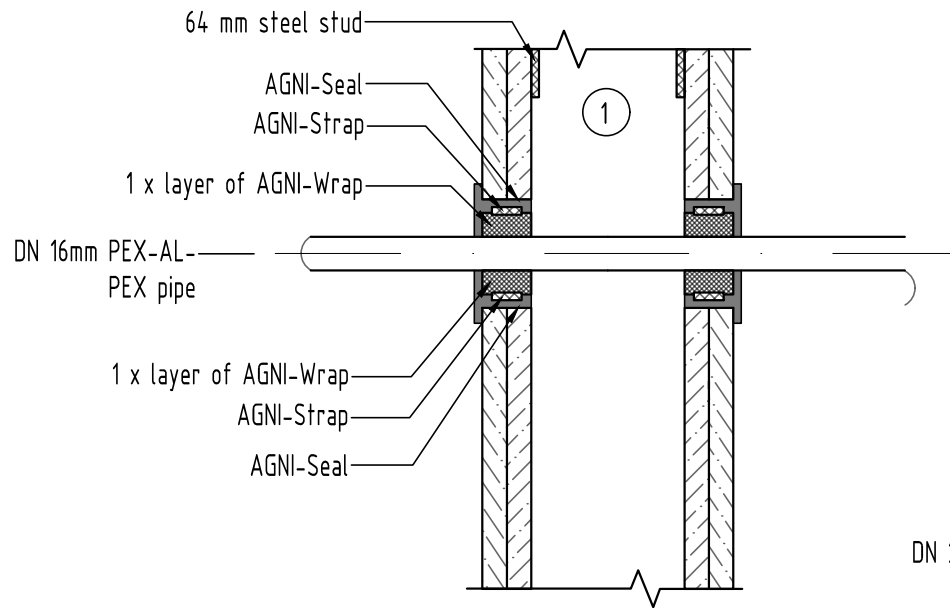

System ID# FC833

### Technical Information

Substrate	<ul style="list-style-type: none"> <li>• 2x 13mm FR plasterboard-lined wall with 64mm steel framing (uninsulated)</li> <li>• ≥116mm concrete wall</li> </ul>	
Service range	DN 16mm PEX-AL-PEX pipe	DN 25mm PEX-AL-PEX pipe
Size	Inner diameter (ID): 11mm Outer diameter (OD): 16.5mm Thickness (T): 2.5mm	Inner diameter (ID): 19mm Outer diameter (OD): 25mm Thickness (T): 2.5mm
AGNI-Wrap layers	1 layer	1 layer
Annular gap	Min: 6.5mm Max: 11.5mm	Min: 8mm Max: 12mm
AGNI-Products	AGNI-Wrap, AGNI-Seal	
Protection installation	Symmetrical	

### Compliance Information

Standards	AS1530.4-2014, AS4072.1-2005
FRR/FRL	DN 16mm -/120/120 DN 25mm -/120/60
Reference	PF24019

**Disclaimer**

Agnitek reserves the right to modify product specifications without prior notice due to its ongoing research, development & certification programme. The information in this document is provided in good faith and is intended for guidance purposes only. Any accompanying drawings are solely for illustrative purposes. Since Agnitek cannot oversee installation methods or ensure site conditions, no warranties, expressed or implied, are intended regarding the products' actual performance. We do not accept liability for any loss, damage, or injury from using this information. Please take a look at the test reports displayed on a relevant AGNI-System webpage for all compliance specifics.



**Agnitek**  
FIRE RATED TECHNOLOGY

8 Clare St Bayswater  
VIC 3153, AUSTRALIA  
www.agnitek.com.au

Date	20.06.2024
------	------------