



FIRESTOP CENTRE

Authorised New Zealand Distributor
Ph (09) 483 4000 www.firestopcentre.co.nz

AGNI-Wrap in 1 x 16mm Ceiling/Floor System PVC Pipe 40mm - 80mm Max FRR -/60/60

System ID# FC839

Step-by-step installation instructions:

1. Ensure the aperture(s) is free from dust and debris.
2. Cut the necessary length of AGNI-Wrap 50.
3. Secure AGNI-Wrap 50 around the pipe with no overlap using AGNI-Strap.
4. Insert AGNI-Wrap 50 into the annular space from the plasterboard side of the ceiling, with 25mm of the wrap inside and 25mm below the ceiling lining.
5. Using AGNI-Seal, seal the joints between AGNI-Wrap 50 and the plasterboard.
6. Apply sealant between AGNI-Wrap 50 and the pipe (optional).
7. Apply AGNI-Seal to seal the annular gap between the plywood and the conduit to the full depth of the plywood.



Technical Information

Substrate	<ul style="list-style-type: none"> • Fire-rated plasterboard ceiling (one layer of 16mm)
Service range	DN 40mm up to 80mm PVC-U pipe
Annular gap	4.5mm - 10mm
AGNI-Products	AGNI-Wrap 50, AGNI-Clip, AGNI-Seal, AGNI-Strap
Protection installation	Asymmetrical

Compliance Information

Standards	AS1530.4-2014, AS4072.1-2005
FRR/FRL	-/60/60
Reference	RIRF24077 (AP-077)



Agnitek[®]
FIRE RATED TECHNOLOGY

8 Clare St Bayswater
VIC 3153, AUSTRALIA
www.agnitek.com.au


Disclaimer

Agnitek reserves the right to modify product specifications without prior notice due to its ongoing research, development & certification programme. The information in this document is provided in good faith and is intended for guidance purposes only. Any accompanying drawings are solely for illustrative purposes. Since Agnitek cannot oversee installation methods or ensure site conditions, no warranties, expressed or implied, are intended regarding the products' actual performance. We do not accept liability for any loss, damage, or injury from using this information. Please take a look at the test reports displayed on a relevant AGNI-System webpage for all compliance specifics.

Date	01.08.2024
------	------------



System ID# FC839

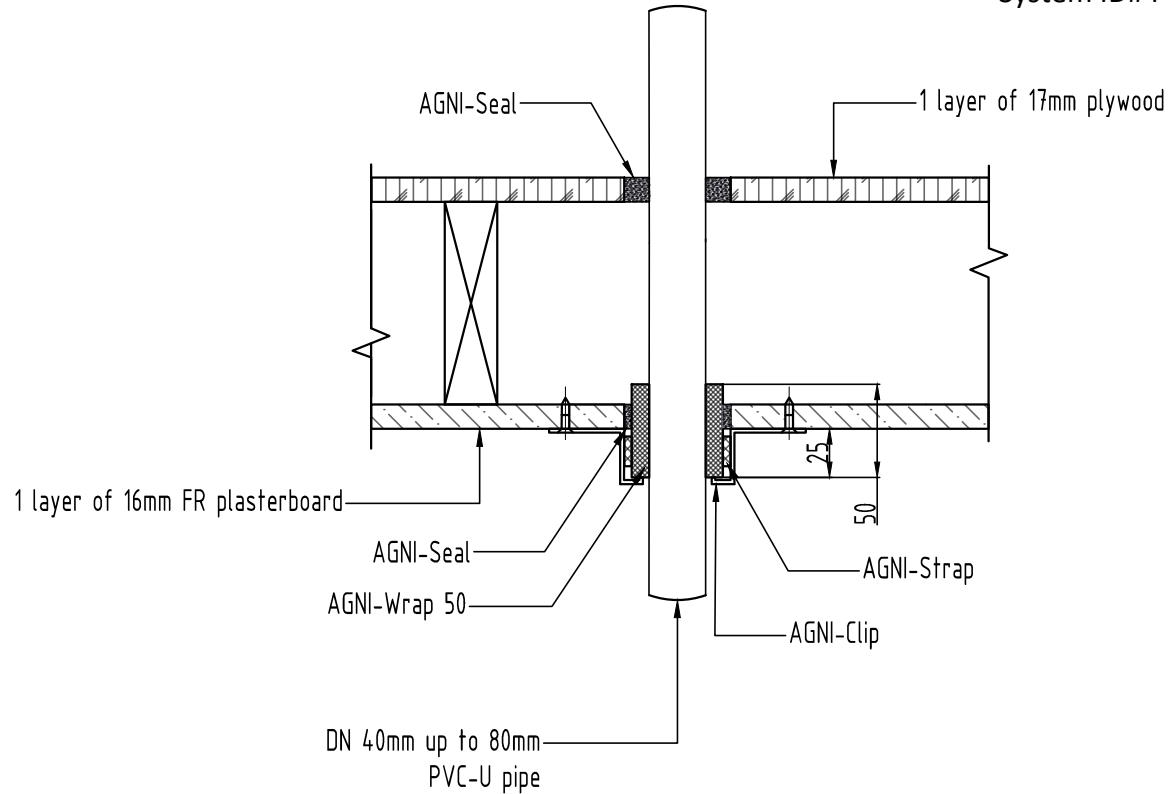

Technical Information

Substrate	<ul style="list-style-type: none"> Fire-rated plasterboard ceiling (one layer of 16mm)
Service range	DN 40mm up to 80mm PVC-U pipe
Annular gap	4.5mm - 10mm
AGNI-Products	AGNI-Wrap 50, AGNI-Clip, AGNI-Seal, AGNI-Strap
Protection installation	Asymmetrical

Compliance Information

Standards	AS1530.4-2014, AS4072.1-2005
FRR/FRL	-/60/60
Reference	RIRF24077



Agnitek[®]
FIRE RATED TECHNOLOGY

8 Clare St Bayswater
VIC 3153, AUSTRALIA
www.agnitek.com.au

Disclaimer

Agnitek reserves the right to modify product specifications without prior notice due to its ongoing research, development & certification programme. The information in this document is provided in good faith and is intended for guidance purposes only. Any accompanying drawings are solely for illustrative purposes. Since Agnitek cannot oversee installation methods or ensure site conditions, no warranties, expressed or implied, are intended regarding the products' actual performance. We do not accept liability for any loss, damage, or injury from using this information. Please take a look at the test reports displayed on a relevant AGNI-System webpage for all compliance specifics.

Date	01.08.2024
------	------------