




FIRESTOP CENTRE

Authorised New Zealand Distributor
Ph (09) 483 4000 www.firestopcentre.co.nz

AGNI-Seal in 1 x 13mm Plasterboard Wall - Single-sided Cables (TPS, data, Coax) FRR - /60/60

System ID# FC846

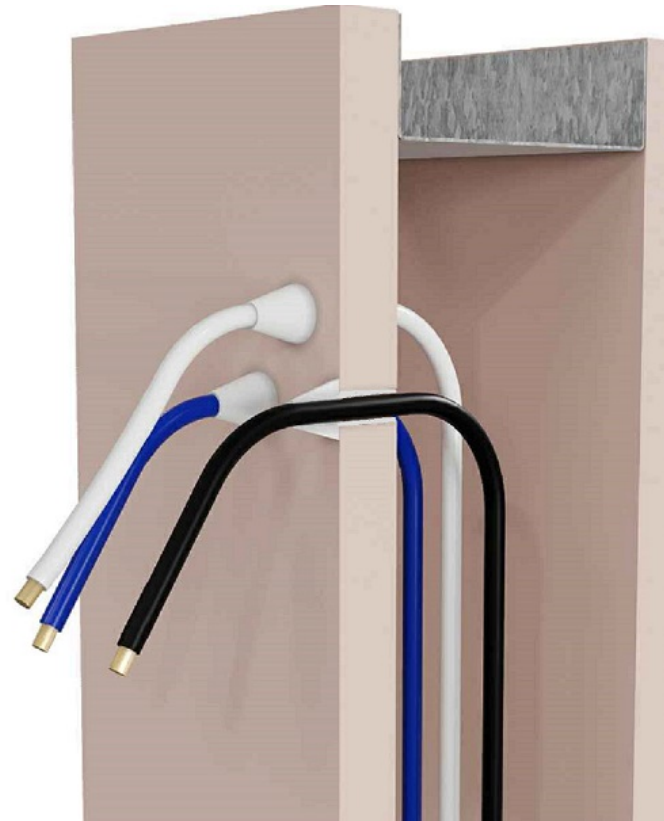

Step-by-step installation instructions:

1. Ensure the aperture(s) is free from dust and debris.
2. Apply 13mm deep seal into annular space.
3. Form a 10mm x 10mm cone of sealant for each cable.

Technical Information

Substrate	<ul style="list-style-type: none"> • Min. 64mm timber or steel stud wall with a minimum of one layer of 13mm (or greater) FR plasterboard on each side, with or without insulation. • Min 90mm masonry wall
Cables	1 x data, 1 x TPS, 1 x COAX spaced by 40mm
Annular gap	2 - 6.5mm
AGNI-Products	AGNI-Seal
Protection installation	Two scenarios: 1) installed on the fire side only; 2) installed on the non-fire side only

Compliance Information

Standards	AS1530.4-2014, AS4072.1-2005
FRR/FRL	-/60/60
Reference	RIRF24068 (AE-069)

Disclaimer

Agnitek reserves the right to modify product specifications without prior notice due to its ongoing research, development & certification programme. The information in this document is provided in good faith and is intended for guidance purposes only. Any accompanying drawings are solely for illustrative purposes. Since Agnitek cannot oversee installation methods or ensure site conditions, no warranties, expressed or implied, are intended regarding the products' actual performance. We do not accept liability for any loss, damage, or injury from using this information. Please take a look at the test reports displayed on a relevant AGNI-System webpage for all compliance specifics.



Agnitek[®]
FIRE RATED TECHNOLOGY

8 Clare St Bayswater
VIC 3153, AUSTRALIA
www.agnitek.com.au


Date	01.08.2024
------	------------



FIRESTOP CENTRE

Authorised New Zealand Distributor
Ph (09) 483 4000 www.firestopcentre.co.nz

AGNI-Seal in 1 x 13mm Plasterboard Wall - Single-sided Cables (TPS, data, Coax) FRR - /60/60

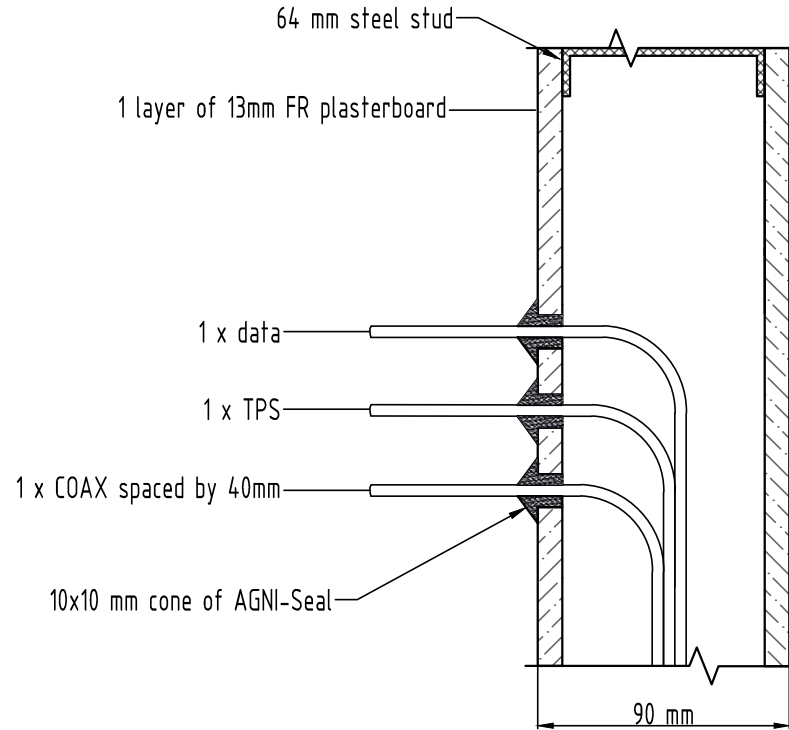

System ID# FC846

Technical Information

Substrate	<ul style="list-style-type: none"> • Min. 64mm timber or steel stud wall with a minimum of one layer of 13mm (or greater) FR plasterboard on each side, with or without insulation. • Min 90mm masonry wall
Cables	1 x data, 1 x TPS, 1 x COAX spaced by 40mm
Annular gap	2 - 6.5mm
AGNI-Products	AGNI-Seal
Protection installation	Two scenarios: 1) installed on the fire side only; 2) installed on the non-fire side only

Compliance Information

Standards	AS1530.4-2014, AS4072.1-2005
FRR/FRL	-/60/60
Reference	PF24068



Agnitek[®]
FIRE RATED TECHNOLOGY

8 Clare St Bayswater
VIC 3153, AUSTRALIA
www.agnitek.com.au

Disclaimer

Agnitek reserves the right to modify product specifications without prior notice due to its ongoing research, development & certification programme. The information in this document is provided in good faith and is intended for guidance purposes only. Any accompanying drawings are solely for illustrative purposes. Since Agnitek cannot oversee installation methods or ensure site conditions, no warranties, expressed or implied, are intended regarding the products' actual performance. We do not accept liability for any loss, damage, or injury from using this information. Please take a look at the test reports displayed on a relevant AGNI-System webpage for all compliance specifics.

Date	01.08.2024
------	------------