



FIRESTOP CENTRE

Authorised New Zealand Distributor
Ph (09) 483 4000 www.firestopcentre.co.nz

AGNI-Seal in a Hebel Wall (min 75mm) Copper or Steel Pipes 32mm-100mm with AGNI-Shield Max FRR -/120/120

System ID# FC894

Step-by-step installation instructions:

1. Ensure the aperture is free from dust and debris.
2. Apply AGNI-Seal into the annular gap around the service to the full depth of the wall.
3. Apply 30mm x 30mm AGNI-Seal fillet/cone around the service.
4. Apply AGNI-Shield as follows:

DN32mm	Above DN32mm up to DN100mm
One layer of 300mm AGNI-Shield	One layer of 450mm AGNI-Shield


with 50mm overlap. Please note that 450mm wide AGNI-Shield consists of a 300mm wide strip to the wall and 150mm wide strip butt jointed and taped with 75mm wide solid aluminium tape.

5. Secure AGNI-Shield to the pipe with:

DN32mm	Above DN32mm up to DN100mm
3 x AGNI-Straps	4 x AGNI-Straps

positioned 50mm from each end and 150mm maximum spacing between each AGNI-Strap with additional AGNI-Straps 50mm from the AGNI-Shield joint.

NOTE: Tested with copper pipes. Steel pipes approved by virtue of AS1530.4 clause 10.12.3.2

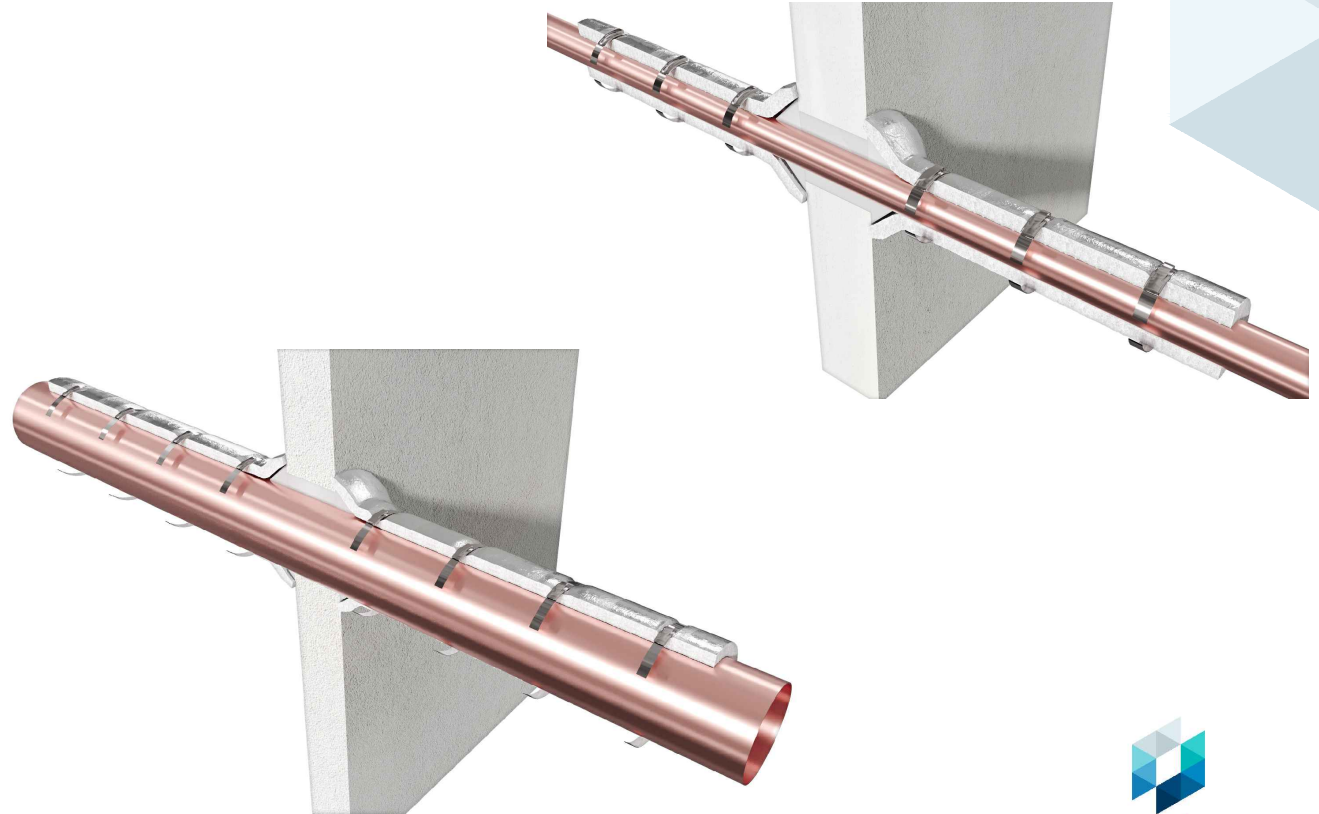

Technical Information

Substrate	Min. 75mm Hebel Wall
Service range	DN32mm, DN100mm copper/steel pipes
Annular gap	DN32mm - 10.3 - 15.3mm DN100mm - 6.9 - 11.4mm
AGNI-Products	AGNI-Seal, AGNI-Shield, AGNI-Straps
Protection installation	From both sides of the wall

Compliance Information

Standards	AS1530.4-2014, AS4072.1-2005
FRR/FRL	-/120/120
Reference	PF24145



8 Clare St Bayswater
VIC 3153, AUSTRALIA
www.agnitek.com.au

Disclaimer


Agnitek reserves the right to modify product specifications without prior notice due to its ongoing research, development & certification programme. The information in this document is provided in good faith and is intended for guidance purposes only. Any accompanying drawings are solely for illustrative purposes. Since Agnitek cannot oversee installation methods or ensure site conditions, no warranties, expressed or implied, are intended regarding the products' actual performance. We do not accept liability for any loss, damage, or injury from using this information. Please take a look at the test reports displayed on a relevant AGNI-System webpage for all compliance specifics.

Date	07.03.2025
------	------------



AGNI-Seal in a Hebel Wall (min 75mm) Copper or Steel Pipes 32mm-100mm with AGNI-Shield Max FRR -/120/120

System ID# FC894

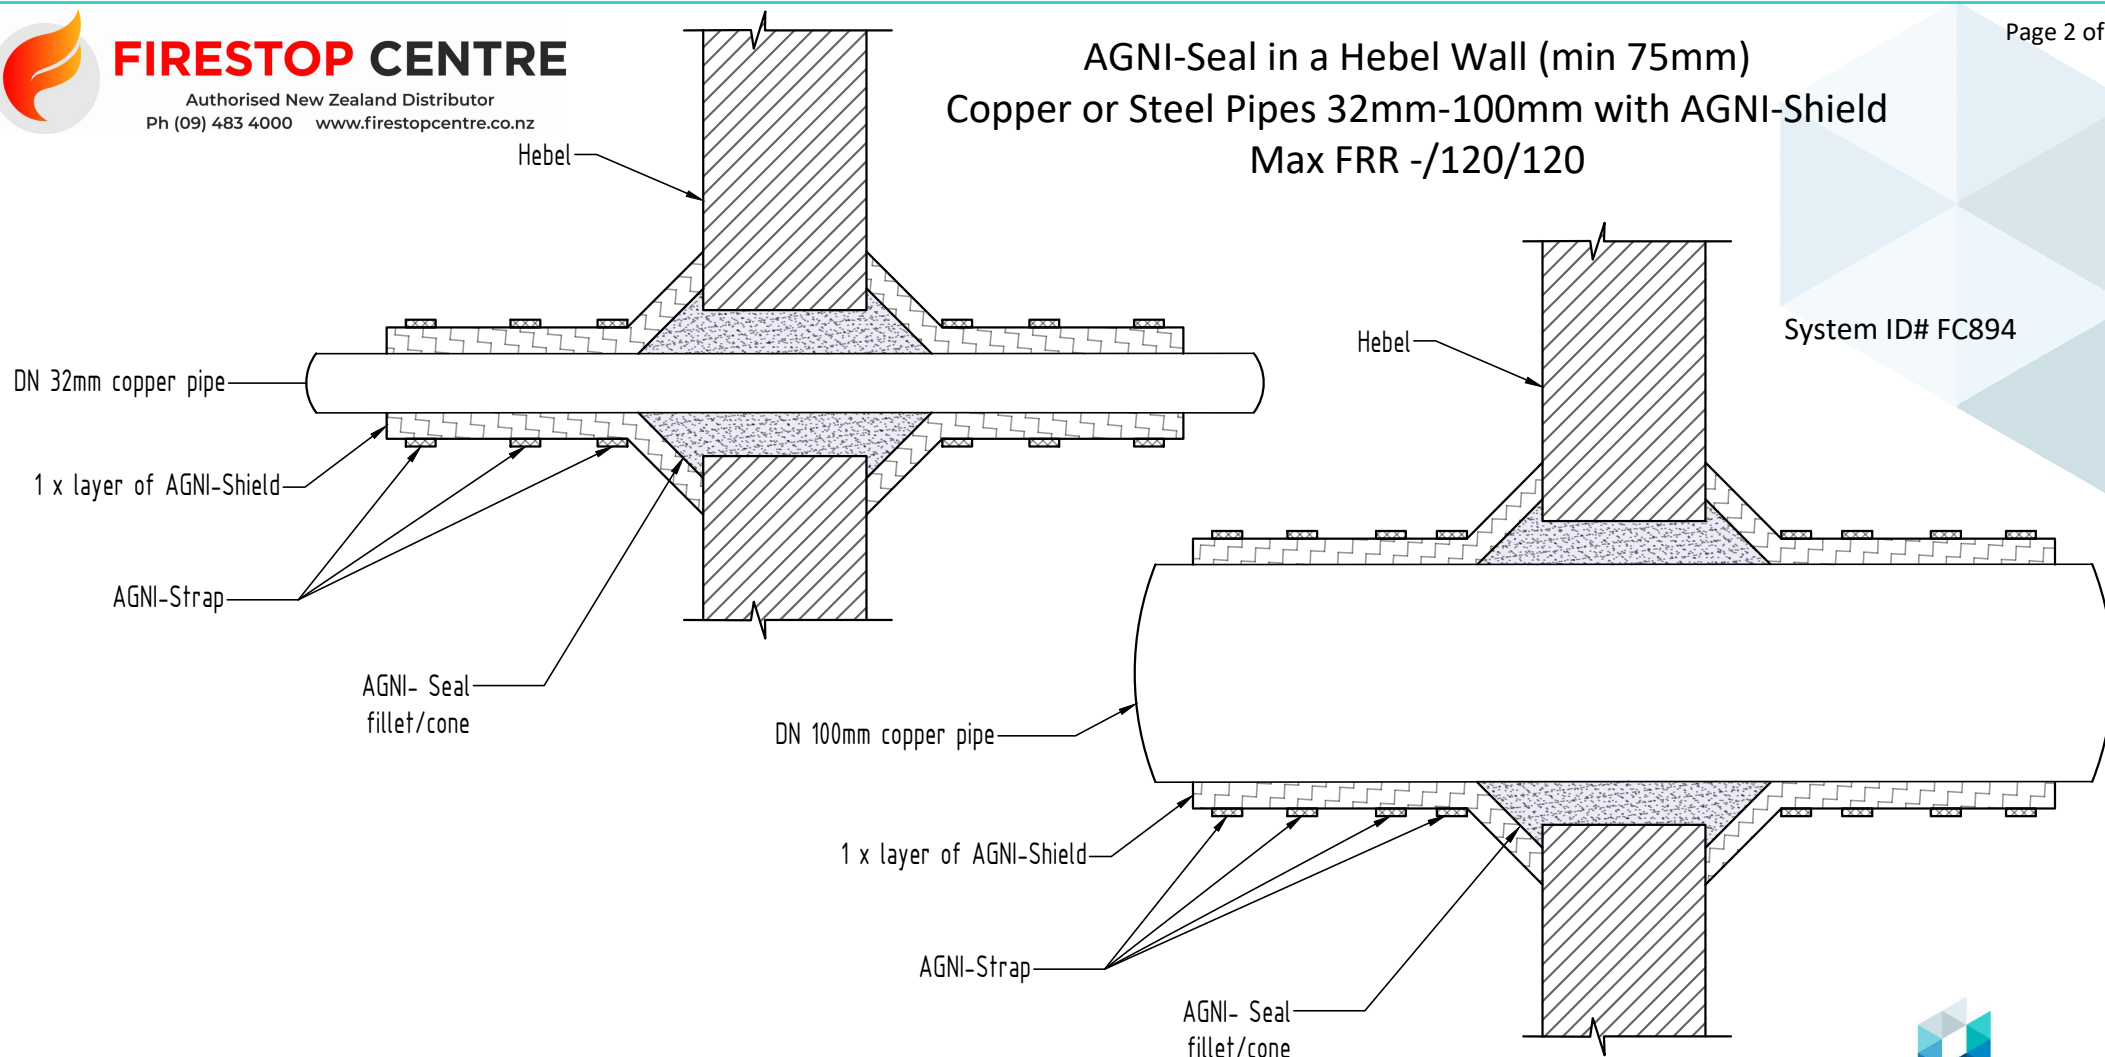

Technical Information

Substrate	Min. 75mm Hebel Wall
Service range	DN32mm, DN100mm copper/steel pipes
Annular gap	DN32mm - 10.3 - 15.3mm DN100mm - 6.9 - 11.4mm
AGNI-Products	AGNI-Seal, AGNI-Shield, AGNI-Straps
Protection installation	From both sides of the wall

Compliance Information

Standards	AS1530.4-2014, AS4072.1-2005
FRR/FRL	-/120/120
Reference	PF24145



Agnitek[®]
FIRE RATED TECHNOLOGY

8 Clare St Bayswater
VIC 3153, AUSTRALIA
www.agnitek.com.au

Disclaimer

Agnitek reserves the right to modify product specifications without prior notice due to its ongoing research, development & certification programme. The information in this document is provided in good faith and is intended for guidance purposes only. Any accompanying drawings are solely for illustrative purposes. Since Agnitek cannot oversee installation methods or ensure site conditions, no warranties, expressed or implied, are intended regarding the products' actual performance. We do not accept liability for any loss, damage, or injury from using this information. Please take a look at the test reports displayed on a relevant AGNI-System webpage for all compliance specifics.

Date 07.03.2025