


Allproof Low Profile Fire Collar PVC or PEX Pipes in CLT Floor (from 70mm)

INSTALLATION INSTRUCTIONS:

1. Ensure substrate around pipe is flat and free from obstructions.
2. Open pipe collar and position around pipe.
3. Slide tab through slot in pipe collar and fold back 180° to secure.
4. Secure pipe collar using 12Gx50mm Tek screws. Do not use fixings which rely on plastic or nylon components for grip.
5. Seal the annular gap between top of slab and the pipe with min 5mm Allproof MAS 310 fire sealant with PE backing rod.
6. Install only from underside on floor penetrations.

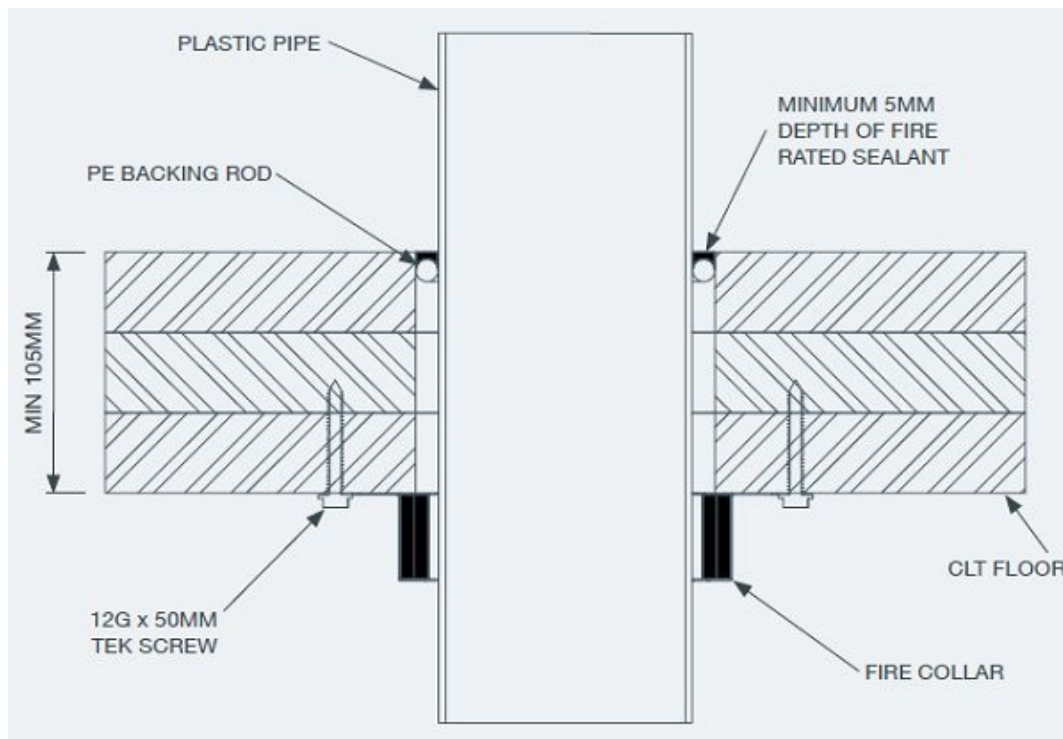

System/FPA Register ID# FC221

Products	Allproof Low-Profile Fire Collar
Application	Fire stopping of plastic pipes in CLT floors
Construction	Minimum floor thickness of 105mm and comprise cross laminated timber

Fire Classification:

PVC Pipe:

40mm diam with 53mm hole size
FRR -/60/60

50mm diam with 66mm hole size
FRR -/60/60

100mm diam with 120mm hole size
FRR -/60/60

PEX Pipe:

16mm diam with 26mm hole size
FRR -/45/45

20mm diam with 30mm hole size
FRR -/30/30

25mm diam with 35mm hole size
FRR -/30/30

ALLPROOF

INDUSTRIES

Allproof Industries Ltd
17 Bay Park Place
Beach Haven, AK 0626

Sheet size:	Drawn date & no:
A4	28/7/2
Scale:	Drawn by:
NTS	G.P



BRANZ Appraised
Appraisal No.1088 [2019]

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Firestop Centre has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, is intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

For all technical details on the products specified please refer to the technical data sheets that can be found on www.firestopcentre.co.nz

Signed and approved: