

## Allproof Low Profile Fire Collar PVC/HDPE Plastic Floor Waste in Concrete Floor (from 70mm)

System/FPA Register ID# FC629

|                     |   |
|---------------------|---|
| <b>Products</b>     | Allproof Low-Profile Fire Collar  |
| <b>Application</b>  | Fire stopping of floor wastes in rigid floors                             |
| <b>Construction</b> | Minimum floor thickness of 70mm and comprise aerated concrete or concrete |

**Fire Classification:**

PVC Plastic pipe in 70mm slab

80mm diam with hole size up to 92mm  
 FRR -/120/120

100mm diam with hole size up to 117mm  
 FRR -/120/-

PVC Plastic Pipe In 120mm floor slab:

50mm diam with hole size up to 67mm  
 FRR -/180/120

80mm diam with hole size up to 92mm  
 FRR -/120/120

100mm diam with hole size up to 112mm  
 FRR -/120/120


PVC Plastic Pipe with Socket in 150mm slab

80mm diam with hole size up to 87mm  
 FFR -/120/0

HDPE Plastic Pipe in 150mm slab  
 110mm diam with hole size up to 112mm  
 FRR -/120/120

**INSTALLATION INSTRUCTIONS:**

1. Ensure substrate around pipe is flat and free from obstructions.
2. Open pipe collar and position around pipe.
3. Slide tab through slot in pipe collar and fold back 180° to secure.
4. Secure pipe collar using M6x25 masonry anchors or M6x4.5 DBZ Wedge Anchors. Do not use fixings which rely on plastic or nylon components for grip.
5. Install only from underside on floor penetrations.
6. Allproof recommends any thermal or acoustic lagging maintains a 50mm separation to the fire collar.

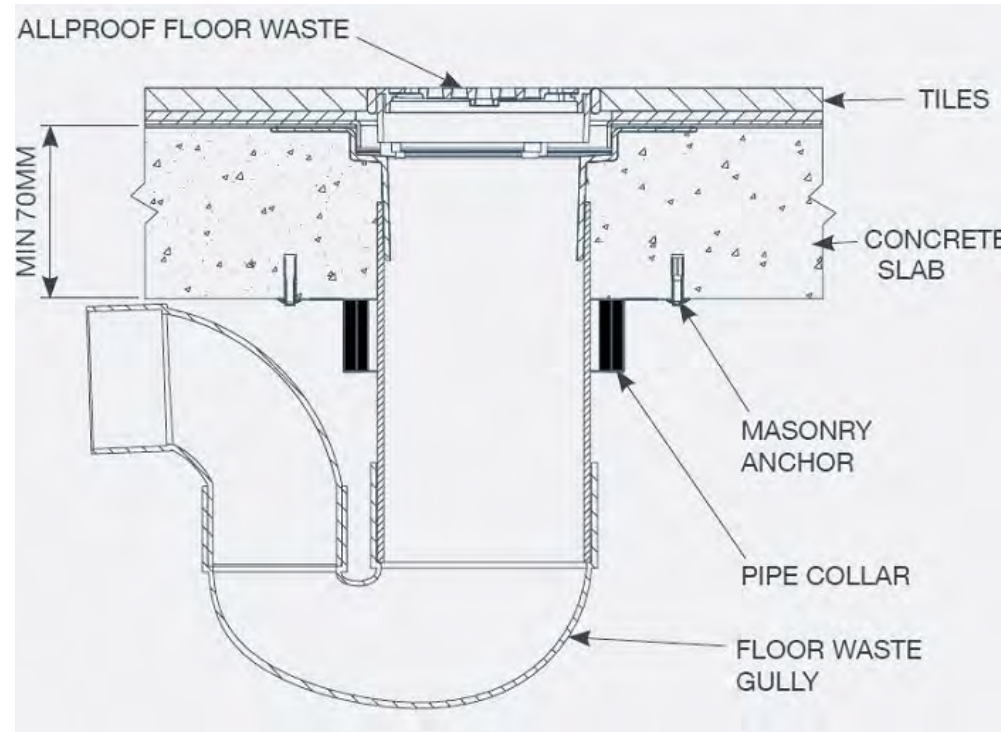

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Firestop Centre has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, is intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

For all technical details on the products specified please refer to the technical data sheets that can be found on [www.firestopcentre.co.nz](http://www.firestopcentre.co.nz)

Signed and approved:

# ALLPROOF

INDUSTRIES

Allproof Industries Ltd  
 17 Bay Park Place  
 Beach Haven, AK 0626

|             |                  |
|-------------|------------------|
| Sheet size: | Drawn date & no: |
| <b>A4</b>   | 28/7/21          |

|            |           |
|------------|-----------|
| Scale:     | Drawn by: |
| <b>NTS</b> | G.P       |