


Allproof Drop-In Fire Collar PVC/HDPE Plastic Floor Waste in Composite Floor (from 70mm topping depth)

System/FPA Register ID# FC687

INSTALLATION INSTRUCTIONS:

1. Core drill hole to specified diameter to suit pipe size.
2. Install drop-in fire collar fixing with two metal pin anchors with the tabs recessed into the slab.
3. Ensure collar on underside of slab is exposed no greater than 80mm and recessed no greater than 5mm.
4. Insert pipework through collar (no sealant required).

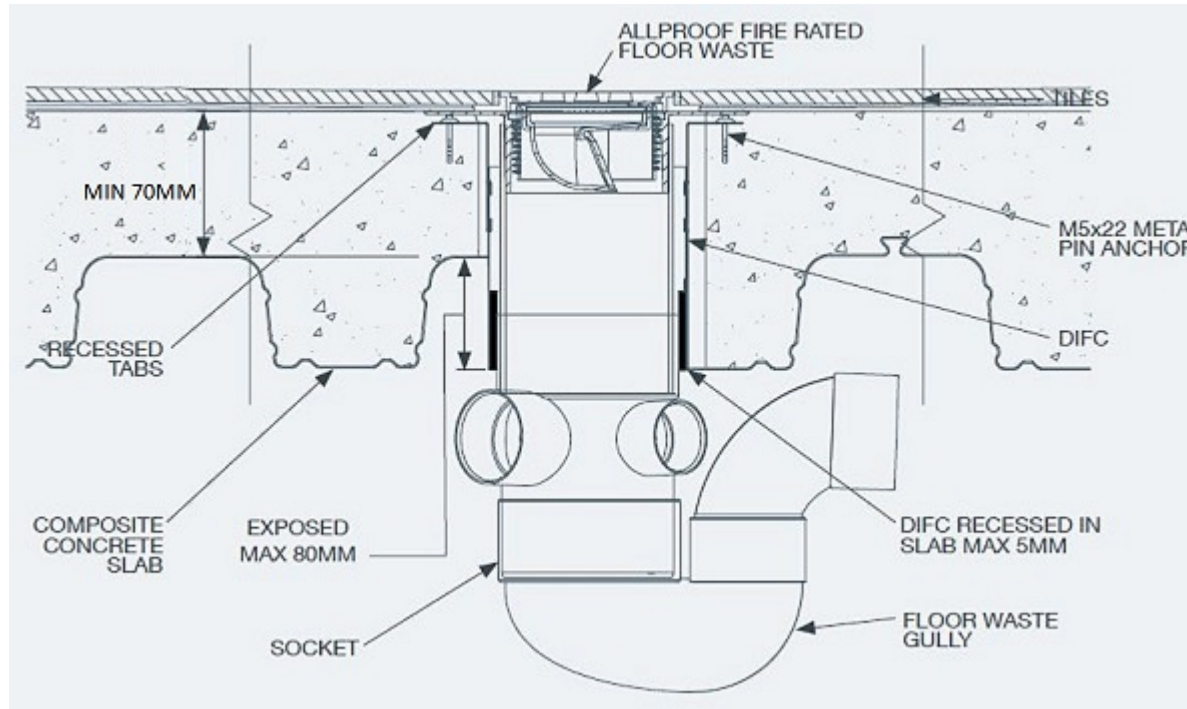

| | |
|---------------------|---|
| Products | Allproof Drop-In Fire Collar |
| Application | Fire stopping of floor waste in composite floor |
| Construction | Minimum topping thickness of 70mm and comprise aerated concrete or concrete |

Fire Classification:

| | |
|--|---------------|
| 80mm diam PVC waste (with socket) in max aperture size 112mm diam - | |
| in floor with 70mm topping | FRR -/60/60 |
| in floor with 100+mm topping | FRR -/120/120 |
| 100mm diam PVC or HDPE waste (with socket) in max aperture size 142mm diam - | |
| in floor with 70mm topping | FRR -/60/60 |
| in floor with 100+mm topping | FRR -/120/120 |

NOTE: Must use Allproof fire-rated floor waste



ComFlor 60 - 70/130 - Tested on a composite floor with 70mm minimum thickness and 130mm maximum thickness. Profile change of 60mm.

ComFlor 80 - 100/180 - Tested on a composite floor with 100mm minimum thickness and 180mm maximum thickness. Profile change of 80mm

ComFlor 210 - 70/280 - Tested on a composite floor with 70mm minimum thickness and 280mm maximum thickness. Profile change of 210mm

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Firestop Centre has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, is intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

For all technical details on the products specified please refer to the technical data sheets that can be found on www.firestopcentre.co.nz

Signed and approved:

ALLPROOF

INDUSTRIES

Allproof Industries Ltd
 17 Bay Park Place
 Beach Haven, AK 0626

| | |
|-------------|------------------|
| Sheet size: | Drawn date & no: |
| A4 | 28/7/23 |
| Scale: | Drawn by: |
| NTS | G.P |


Allproof Drop-In Fire Collar
 PVC/HDPE Plastic Floor Waste in Composite Floor
 (from 70mm topping depth)



System/FPA Register ID# FC687

| | |
|---------------------|---|
| Products | Allproof Drop-In Fire Collar |
| Application | Fire stopping of floor waste in composite floor |
| Construction | Minimum topping thickness of 70mm and comprise aerated concrete or concrete |

ASSESSED COMPOSITE FLOOR TRAY PROFILES

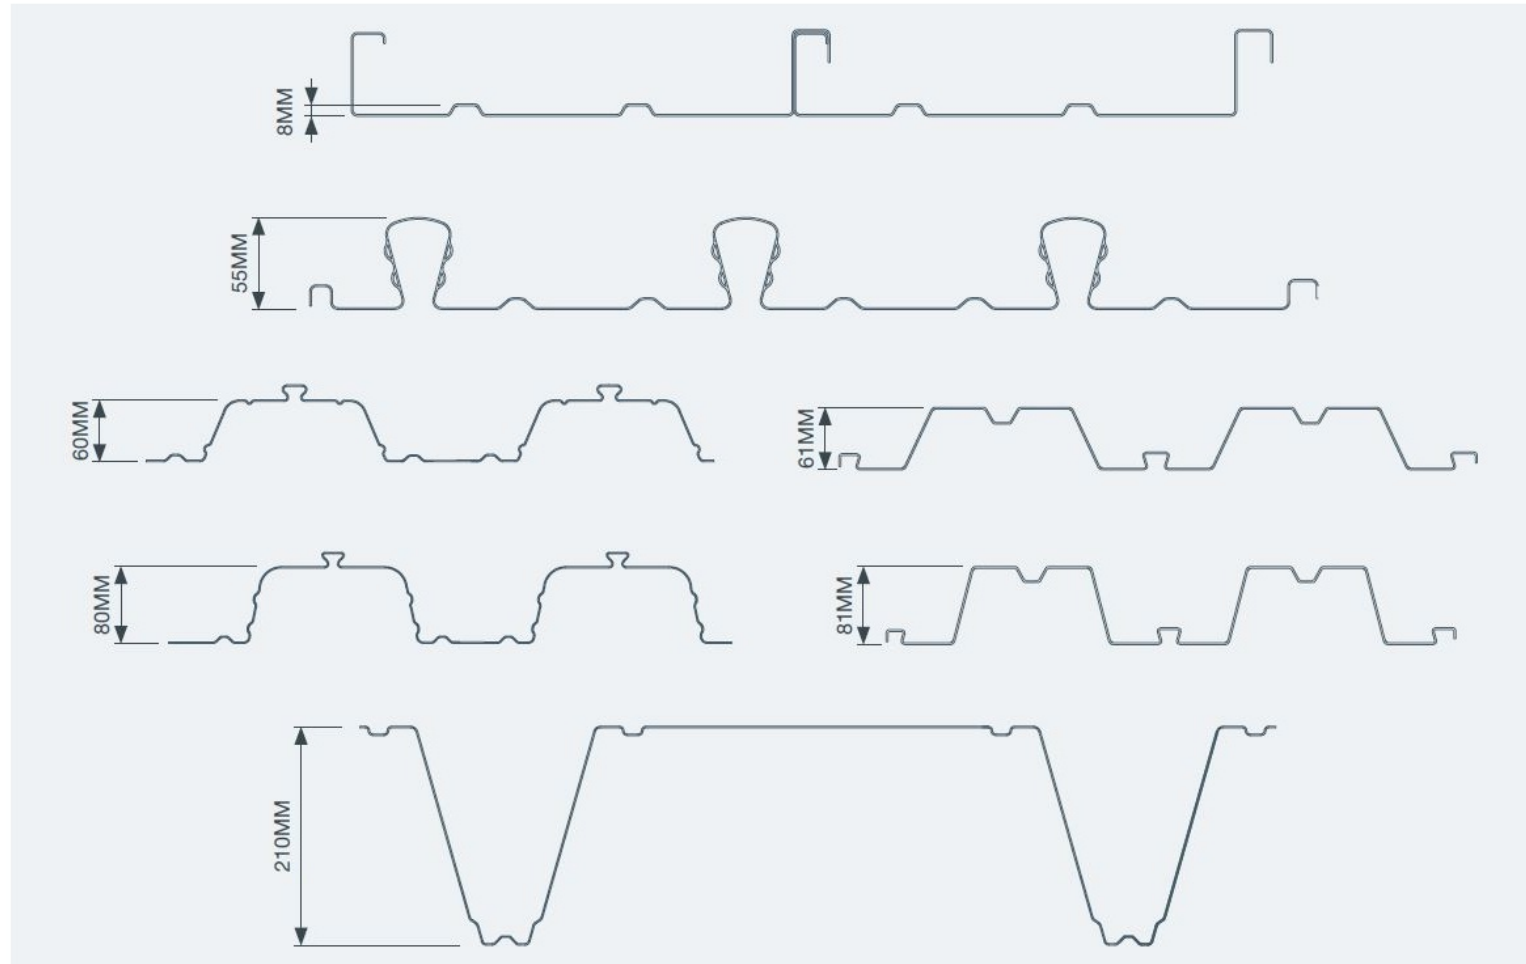

Fire Classification:

80mm diam PVC waste (with socket) in max aperture size 112mm diam -
 in floor with 70mm topping FRR -/60/60
 in floor with 100+mm topping FRR -/120/120

100mm diam PVC or HDPE waste (with socket) in max aperture size 142mm diam -
 in floor with 70mm topping FRR -/60/60
 in floor with 100+mm topping FRR -/120/120

NOTE: Must use Allproof fire-rated floor waste

ALLPROOF
 INDUSTRIES

Allproof Industries Ltd
 17 Bay Park Place
 Beach Haven, AK 0626

| | |
|--------------------------|-----------------------------|
| Sheet size: A4 | Drawn date & no: 28/7/21 |
| Scale: NTS | Drawn by: G.P |