

## Allproof Low Profile Fire Collar Cables inc Fibre Optic through a 70mm Concrete Floor




System/FPA Register ID# FC773

<b>Products</b>	Allproof Low-Profile Fire Collar
<b>Application</b>	Fire stopping of cables and pair coils in concrete floor
<b>Construction</b>	Concrete floor minimum 70mm thick

### INSTALLATION INSTRUCTIONS:

1. Ensure substrate around the service is flat and free from obstructions.
2. Seal the annular space between the top of the floor and the cables with 5mm Allproof MAS310 fire sealant.
3. Open pipe collar and position around the cables.
4. Slide tab through slot in pipe collar and fold back 180° to secure.
5. Secure collar using M6 x 45mm wedge anchors fixed into the concrete floor. Do not use fixings which rely on plastic or nylon components for grip.

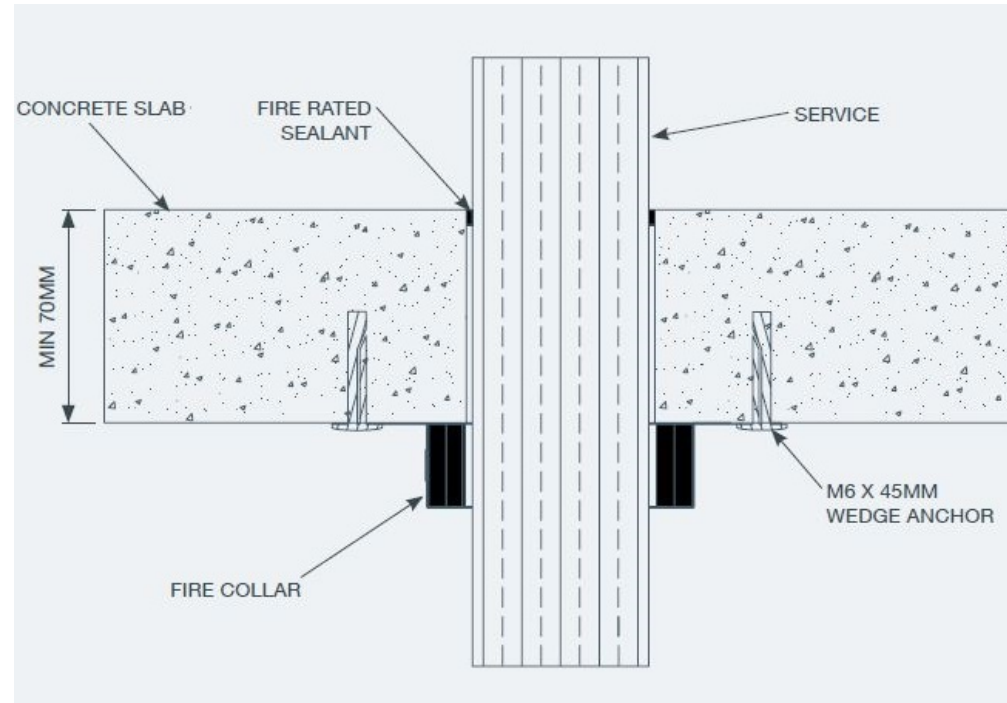

### Fire Classification:

1 x 25mm mains cable and 1 x 10mm earth cable with 25mm collar in max aperture 28mm diam	FRR -/60/45
10 x CAT6 data cables with 25mm collar in max aperture 28mm diam	FRR -/60/60
7 x TPS cables with 25mm collar in max aperture 28mm diam	FRR -/60/45
25x Fire Alarm & 25x Fibre Optic cables with 50mm collar in max aperture 62mm diam	FRR -/60/60



BRANZ Appraised  
 Appraisal No.1088 [2019]

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Firestop Centre has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, is intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

For all technical details on the products specified please refer to the technical data sheets that can be found on [www.firestopcentre.co.nz](http://www.firestopcentre.co.nz)

Signed and approved:

# ALLPROOF

INDUSTRIES

Allproof Industries Ltd  
 17 Bay Park Place  
 Beach Haven, AK 0626

Sheet size: <b>A4</b>	Drawn date & no: 28/7/21
Scale: <b>NTS</b>	Drawn by: G.P