


Protecta FR Acrylic Single Layer 13mm Plasterboard Wall Conduit

Installation Instructions

1. Before installing Protecta® FR Acrylic ensure that the surface of all service penetrations and surrounding construction is free from all loose contaminants, dust and grease.
2. Where Protecta® FR Acrylic is to be installed against surfaces that cannot tolerate direct contact; appropriate surface preparation should be made (contact Polyseam for guidance in these cases). For paints sensitive to sealing compounds, priming with a PVA primer is recommended.
3. When installing any backing material, cut this slightly oversize and insert into the gap ensuring a tight friction fit. Ensure correct depth is achieved.
4. Fill the gap or joint with Protecta® FR Acrylic to the required depth.
5. Apply the sealant generously to prevent air bubbles. Finish the bead with a moist spatula, pallet knife or brush.
6. Protecta® FR Acrylic can be over-painted with most emulsion or alkyd (gloss) paints.

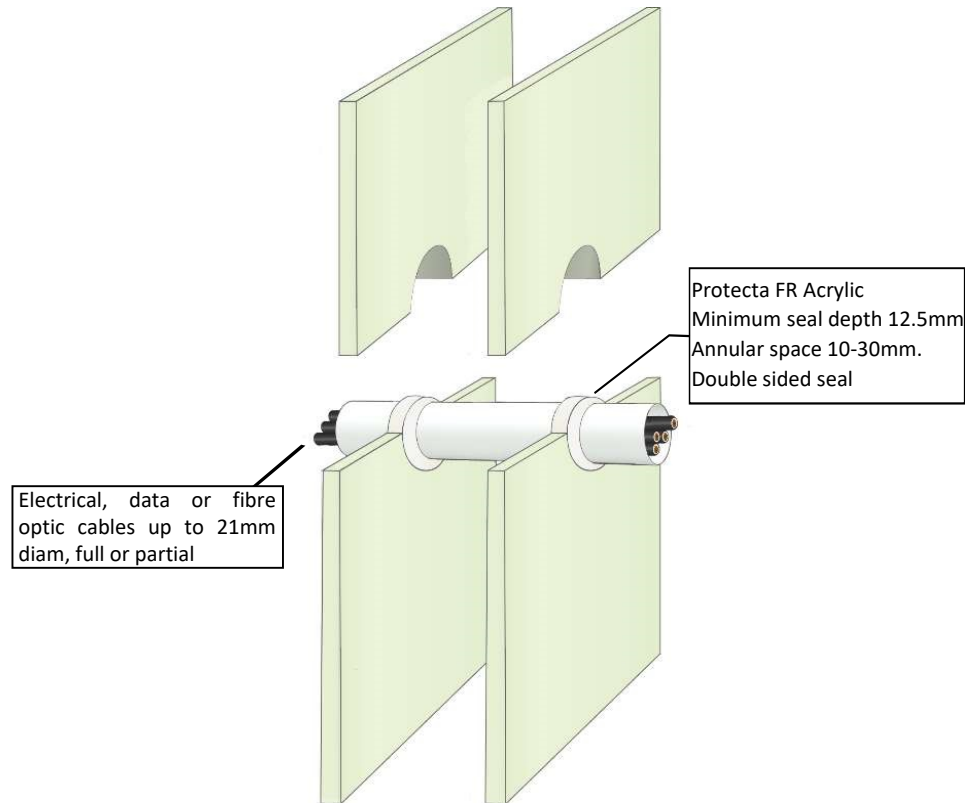

System/FPA Register ID# FC469

Products	Protecta FR Acrylic
Application	Fire stopping of plastic conduits in flexible walls
Construction	Minimum wall thickness of 75mm comprising steel or timber studs lined on both faces with minimum 1 layer of 12.5mm thick board.

Fire & Sound Classification

PVC, PVC-U, PVC-C conduit up to 32mm with wall thickness up to 1.8mm	FRR -/60/45
PE, PE-HD, PEX, ABS & SAN+PVC conduit up to 32mm with wall thickness up to 3.0mm	FRR -/45/30
PP, PP-R, PP-H conduit up to 32mm with wall thickness up to 4.4mm	FRR -/45/30
Conduit may be fully or partially filled with cables	
ZERO smoke leakage up to 200Pa	
Sound reduction (seal only)	STC 62

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, is intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

For all technical details on the products specified please refer to the technical data sheets that can be found on www.firestopcentre.co.nz

Signed and approved:

Sheet size: A4	Drawn date & no: 9/4/18
Scale: NTS	Drawn by: K.B



Protecta®

Polyseam Ltd, 15 St Andrews Road,
Huddersfield, West Yorkshire, HD1 6SB