


Installation Instructions

1. A single collar is installed on the underside of the floor.
2. Before fitting the collar ensure that any gaps between the pipe and the floor slab are sealed top and bottom with 25mm deep Protecta® FR Acrylic on 25mm deep backing of stonewool. (Any stonewool, rockwool or mineral wool of density 33kg/m³ is acceptable). Alternatively FR Acrylic to the full depth of the stonewool may be used if more convenient.
3. Place a collar around the pipe and ensure that the fixing lugs are positioned tightly to the surface of the floor so that the fixings can be inserted fully.
4. Where the surface is uneven, apply a sealing bead of Protecta® FR Acrylic between the floor and the collar.
5. Attach the collar with 100mm wood screws.
6. On sites where the penetration size is greater than the pipe diameter and/or the pipe is on an angle, an oversized collar can be used, i.e. the internal diameter of the collar can be larger than the pipe.
7. For visual integrity gaps between pipe and collar may optionally be sealed with a thin bead of FR Acrylic sealant.

Protecta FR Collar Solid Timber or CLT Floor 150mm Metal or Plastic Pipes Combustible (Elastomeric) or Non-Combustible Insulation See Pg 2 for details

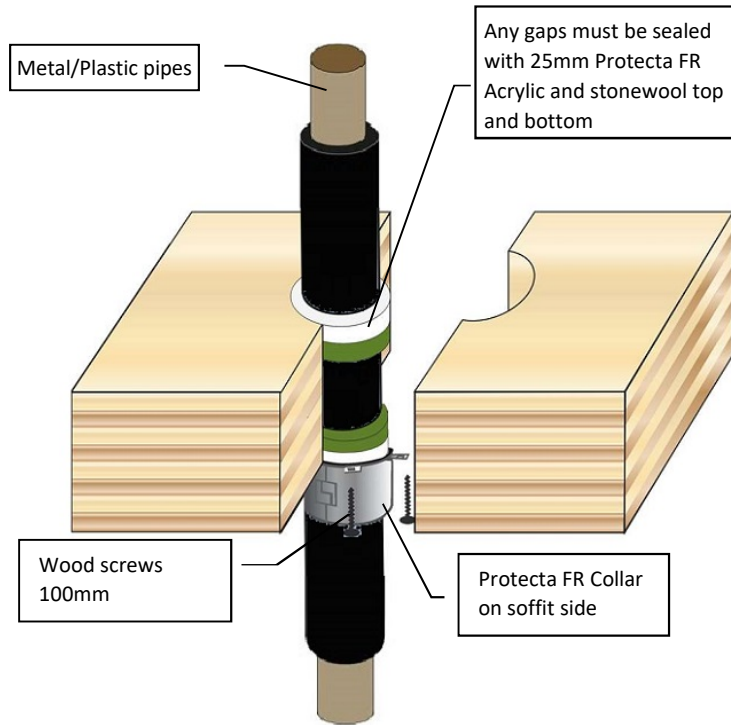

warringtonfire

FAS 190125 AS1530.4-2014 AS4072.1-2005

System/FPA Register ID# FC596

Products	Protecta FR Collar Protecta FR Acrylic
Application	Fire stopping of insulated pipes in timber floors
Construction	Minimum floor thickness of 150mm and comprise solid timber or CLT with a minimum density of 480kg/m ³

Fire & Sound classification

Copper, Steel, Alupex, PE or PP pipes with Elastomeric or mineral wool insulation

See page 2 for details

Over-sized collars of any dimension approved (see pages 9 & 52), subject to:
Max angle 45°
Max FRR -/120/120
Max collar size 160mm
Max average annular space 55mm

ZERO Smoke leakage up to 200Pa

Sound reduction (seal only)

STC 58



Protecta®

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, is intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

For all technical details on the products specified please refer to the technical data sheets that can be found on www.firestopcentre.co.nz

Signed and approved:

Sheet size: Drawn date & no:

A4

28/7/21

Scale:

NTS

Drawn by:

K.B

Protecta FR Collar
 Solid Timber or CLT Floor 150mm
 Metal or Plastic Pipes
 Combustible (Elastomeric) or Non-Combustible
 Insulation

System/FPA Register ID# FC596

Products	Protecta FR Collar Protecta FR Acrylic
Application	Fire stopping of insulated pipes in timber floors
Construction	Minimum floor thickness of 150mm and comprise solid timber or CLT with a minimum density of 480kg/m ³

Fire & Sound Classification

Over-sized collars of any dimension approved (see page 9), subject to:
 Max angle 45°
 Max FRR -/120/120
 Max collar size 160mm
 Max average annular space 55mm

 Sound reduction (seal only) STC 58


Protecta®

 Polyseam Ltd, 15 St Andrews Road,
 Huddersfield, West Yorkshire, HD1 6SB

Tel: +44 (0) 148 4421036

Email: post.uk@polyseam.com

Sheet size: A4	Drawn date & no: 28/7/21
--------------------------	-----------------------------

Scale: NTS	Drawn by: K.B
----------------------	------------------

Services	Wall thickness	Collar Height	Collar Size	Insulation Thickness	Classification
Steel or Copper Pipe		Insulation may be combustible Elastomeric or non-combustible mineral wool / rockwool			
Up to 42mm diam	Up to 14.2mm	50mm	Up to 63mm diam	9mm	FRR -/120/120
" "	" "	50mm	Up to 110mm diam	10mm - 50mm	FRR -/60/60
" "	" "	60mm	Up to 160mm diam	" "	FRR -/60/60
Up to 54mm diam	" "	50mm	Up to 110mm diam	19mm	FRR -/120/60
Alupex Pipe					
Up to 75mm diam	Up to 4.6mm	50mm	Up to 110mm diam	9mm	FRR -/120/120
" "	" "	50mm	Up to 110mm diam	10mm - 50mm	FRR -/120/90
" "	" "	60mm	Up to 200mm diam	" "	FRR -/120/90
PE, PE-LD, PE-MD, PE-HD, PE-X, ABS, SAN+PVC and similar					
Up to 160mm diam	Up to 9.5mm	50mm	Up to 110mm diam	9mm	FRR -/180/180
" "	" "	60mm	Up to 200mm diam	"	FRR -/180/180
" "	" "	50mm	Up to 110mm diam	10mm - 50mm	FRR -/120/120
" "	" "	60mm	Up to 200mm diam	" "	FRR -/120/120
" "	" "	75mm	Up to 315mm diam	" "	FRR -/120/120
PP, PP-MV, PP-H, PP-R and similar					
Up to 160mm diam	Up to 9.1mm	50mm	Up to 110mm diam	9mm	FRR -/120/120
" "	" "	60mm	Up to 200mm diam	"	FRR -/120/120
" "	" "	50mm	Up to 110mm diam	10mm - 50mm	FRR -/60/60
" "	" "	60mm	Up to 200mm diam	" "	FRR -/60/60
" "	" "	75mm	Up to 315mm diam	" "	FRR -/60/60

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, is intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

For all technical details on the products specified please refer to the technical data sheets that can be found on www.firestopcentre.co.nz

Signed and approved: