


Protecta FR Collar - Solid Timber or CLT Wall Bare Metal Pipes

Installation Instructions

1. For sealing pipes, a pipe collar is installed on both sides of the wall.
2. Before fitting the pipe collar ensure that any gaps between the pipe and the separating element are sealed. Gaps between the pipe and the construction must be plugged with 25mm deep Protecta FR Acrylic on 25mm deep backing of stone-wool (or 50mm FR Acrylic).
3. Place a pipe collar around the service penetration (pipe) and ensure that the fixing lugs are positioned tightly to the surface of the wall so that the 80mm wood screw fixings can be inserted fully.
4. Where the surface is uneven, apply a sealing bead of Protecta® FR Acrylic between the wall and the pipe collar.
5. Annular gap must be minimum 10mm for pipe sizes up to 160mm.
6. On sites where the penetration size is greater than the pipe diameter and/or the pipe is on an angle an oversized collar can be used. Protecta® FR Collars are tested 'oversize', i.e. the internal diameter of the collar can be larger than the pipe.

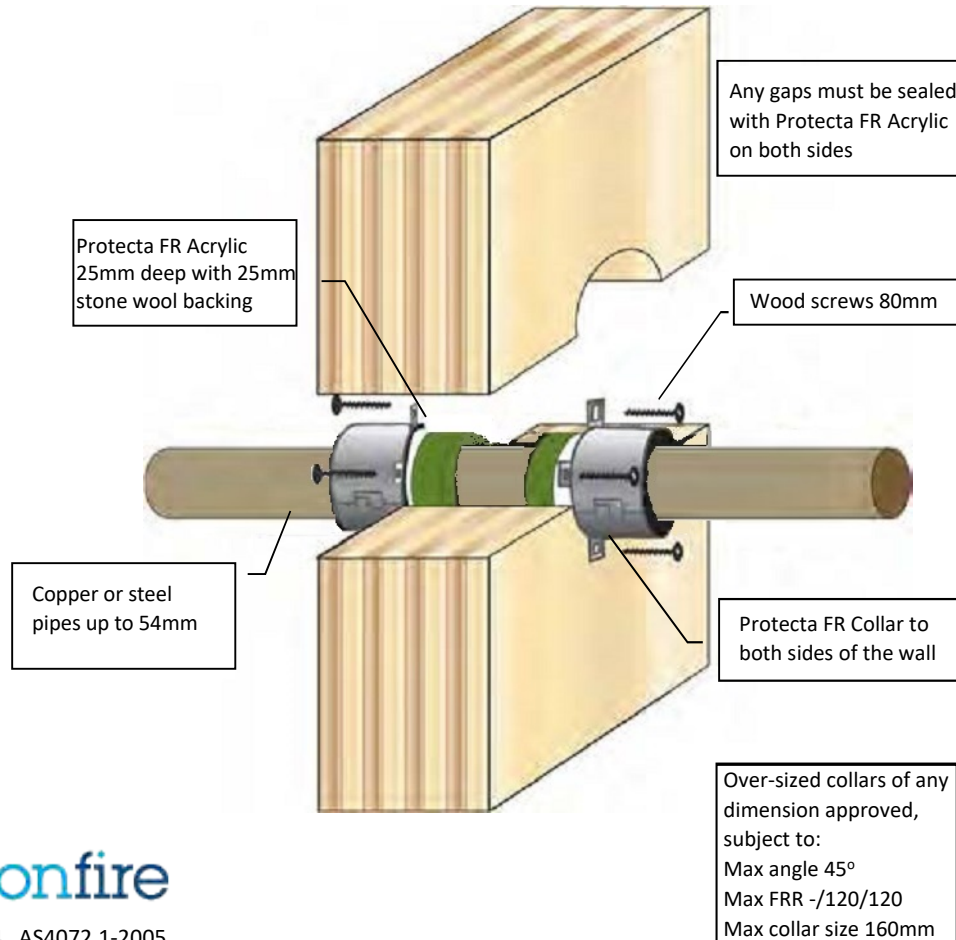

System/FPA Register ID# FC609

Products	Protecta FR Collar Protecta FR Acrylic
Application	Fire stopping of bare metal pipes in timber walls.
Construction	Minimum wall thickness of 100mm and comprise solid wood or cross-laminated timber with min density 510kg/m ³

Fire & Sound classification

Copper or mild steel pipes, diameter up to 54mm:
With 50mm FR Collar up to 110mm or
60mm FR Collar up to 160mm FRR -/120/90

ZERO smoke leakage up to 200Pa

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, is intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

Sound reduction (seal only) STC 58

Sheet size: A4	Drawn date & no: 28/7/20
--------------------------	-----------------------------

Scale: NTS	Drawn by: K.B
----------------------	------------------