


Rigid floor constructions

Control joint, between floor slabs or between floor slab and concrete wall with sealant to the top face of the floor only

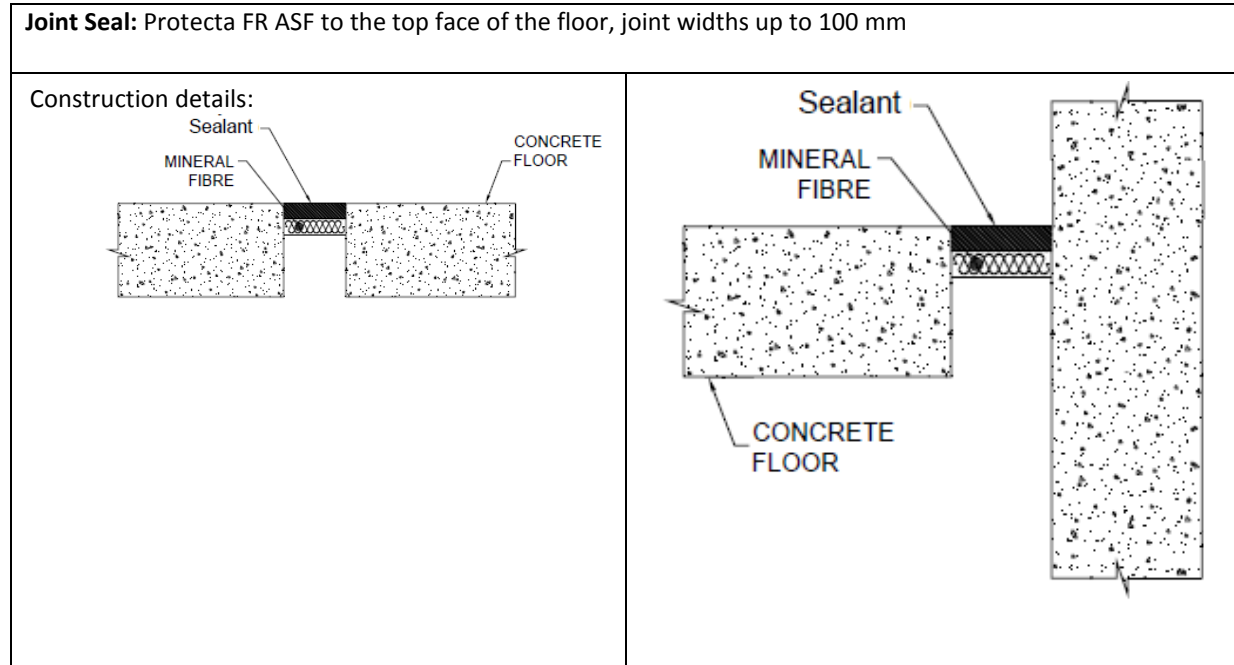

Substrate	Min. Floor thickness (mm)	Sealant depth minimum	Backing material	Maximum Joint Width (mm)	Performance	
					Integrity (mins)	Insulation (mins)
Concrete	150	25 mm	25 mm Stone wool 35 kg/m ³	100	120	120
	64				90	90